

**D-Valves Ltd.**

6133 -97 St.  
Edmonton, Alberta T6E 3J3  
Phone (780) 436-5353 Fax (780) 436-7653

We certify that all inside blow-out preventers, Kellycocks and valves supplied on the work order listed below, are manufactured to meet all requirements in accordance with:

American Petroleum Institute (A.P.I.)  
National Association of Corrosion Engineers (NACE) MR-01-75 specifications  
Alberta Recommended Practices (A.R.P.)

All valves have been pressure tested and charted.

Customer: Viper Rentals  
Work Order # 26088  
Serial # D01-438-01  
VRS-712


Date: April 10, 2002  
Size: 2 9/16 Wkxn Threaded Gate Valve  
Pressure: 5,000 PSI

Part	Number	Part	Number
Body	D01-438-01	Bonnet	D01-438-02
Gate	D01-438-03	Gate	D01-438-04
Seat	D01-438-05	Seat	D01-438-06
Stem	D01-438-07		

Authorized Signature



Viper Rentals & Services  
2 9/16 WKM Threaded Gate Valve

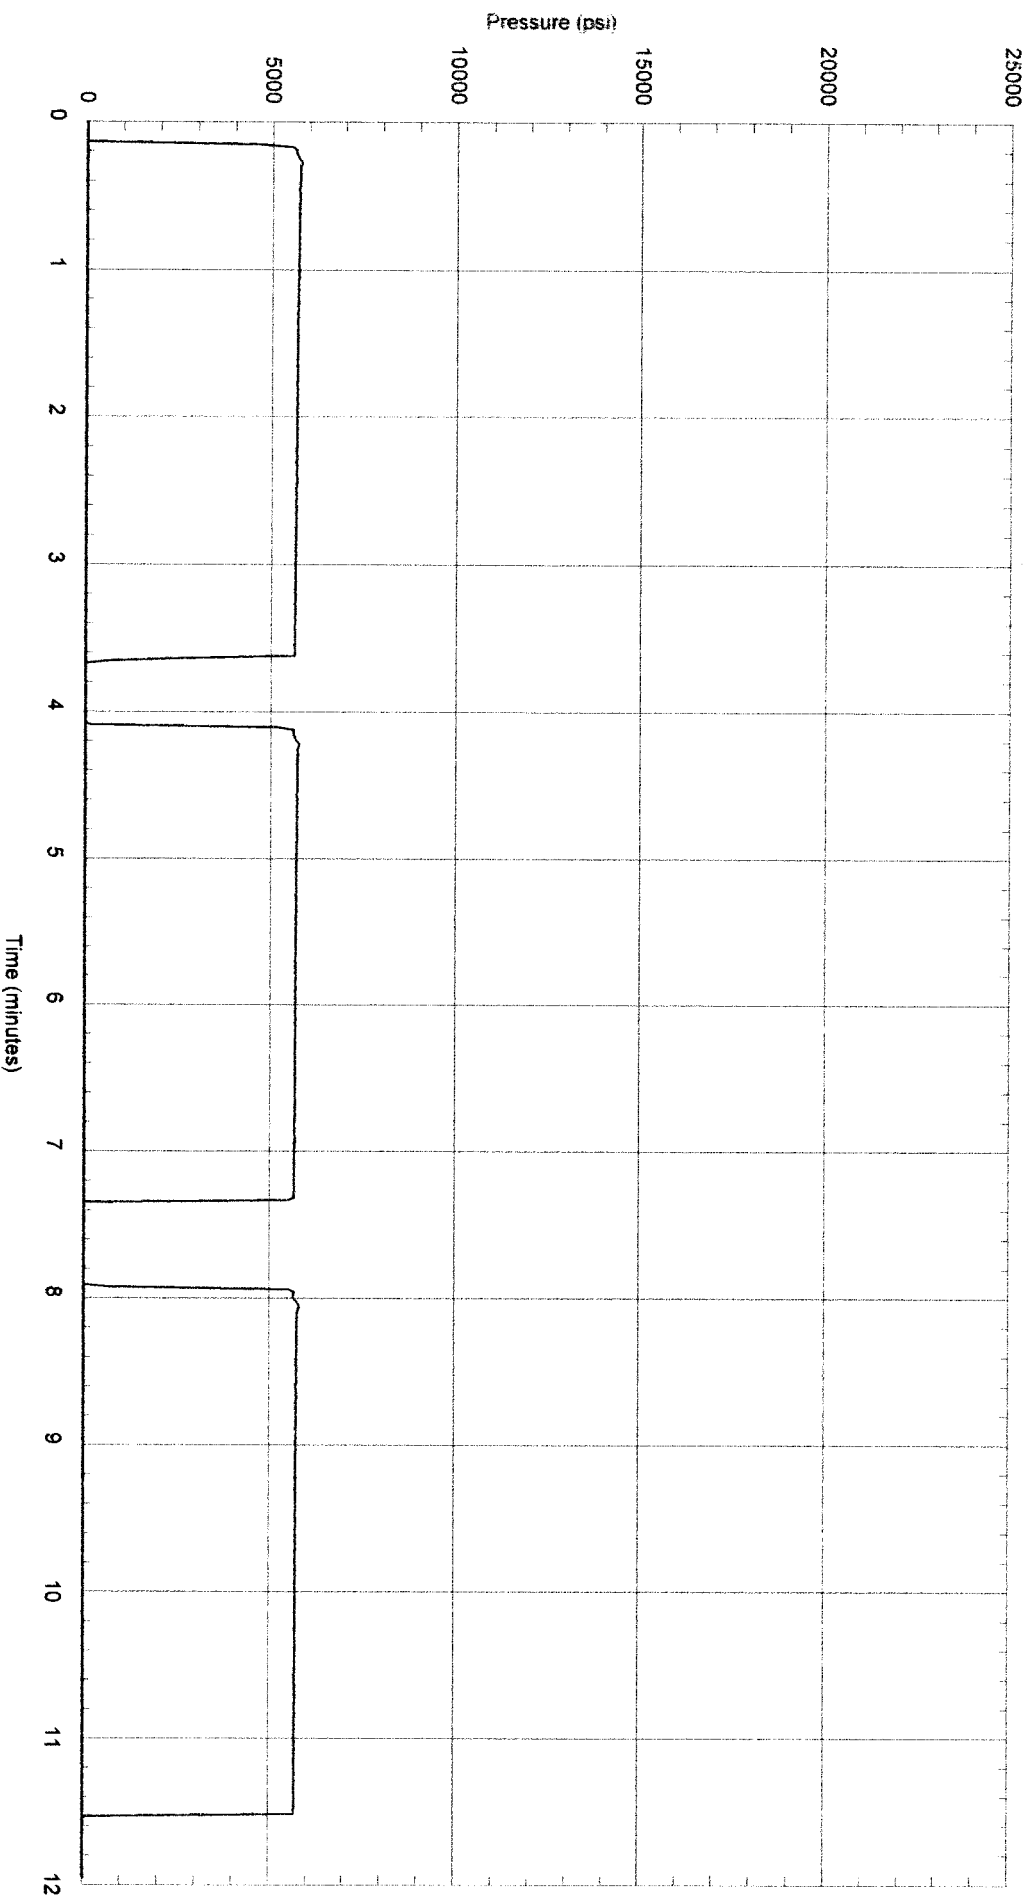

Date: November 22, 2011 03:47:32 PM  
Work Order #: 77777  
Serial #: VRS-712  
Unit #: 4  
A #:   
Tested By: Chadwick